

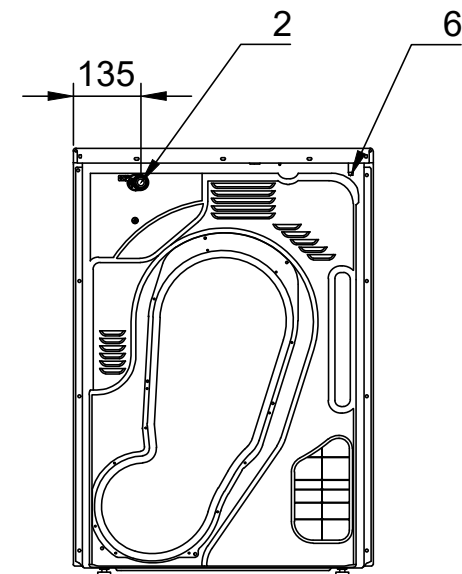
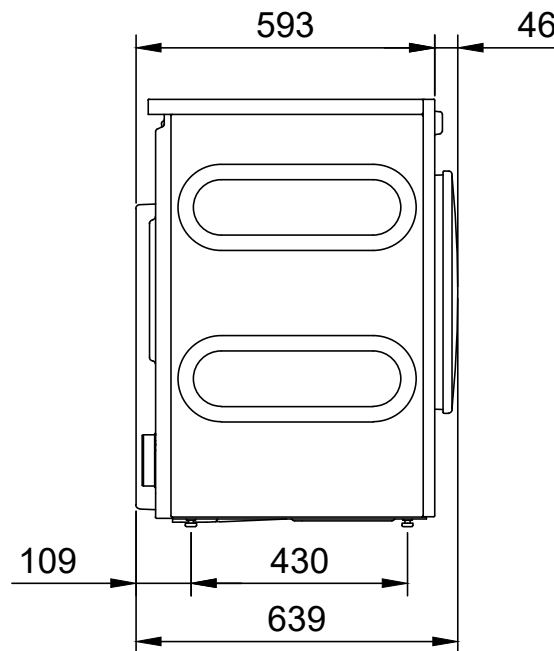


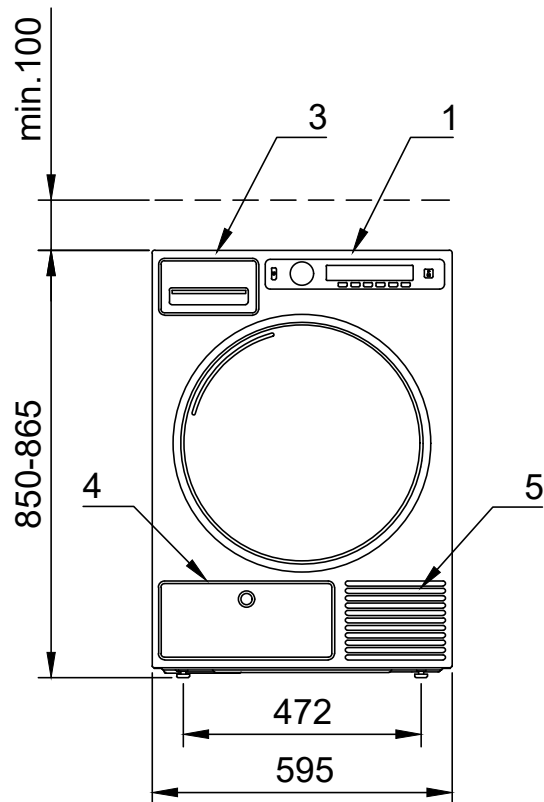

1. Control panel
2. Electrical connection: Cable length 1,5m
3. Condensate tank
4. Condenser unit
5. Air vents
6. Possibility to run the condensate drain hose into a drain

Code	Electric supply	P/kW	Fuse/A
4160740MT	1PE AC 230V 50Hz	2,5	16

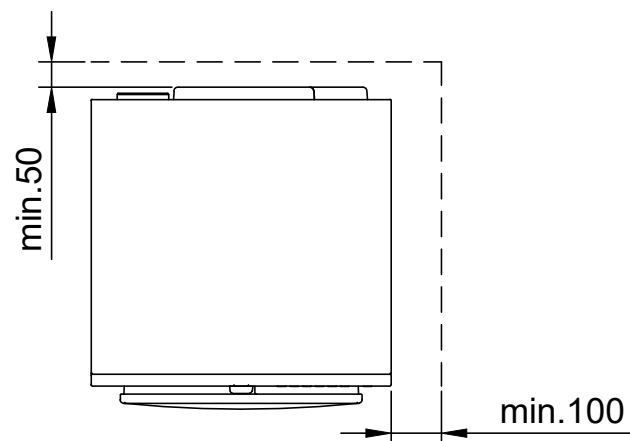

Vers.	Muutos:	Pvm.	Suun.
Tämä piirustus on Metos Oy Ab:n omaisuutta, kopiointi tai osittainenkin jäljentäminen ilman Metos Oy Ab:n lupaa on ehdottomasti kielletty. This document may not be copied in part or in whole by any process nor passed on to a third party without the written permission of the owner Metos Oy Ab.			
Suun.		Työmaa-asiat:	
Suhde: 1: 15 A4		Proj.no	Pvm. 28.05.2021
		Nimitys: Dryer DAMC7	
Metos Oy Ab FI-04220 KERAVA Tel: 0204 39 13 Fax: 0204 39 4432		Piir.no Lehti	